OUT OF SERVICE

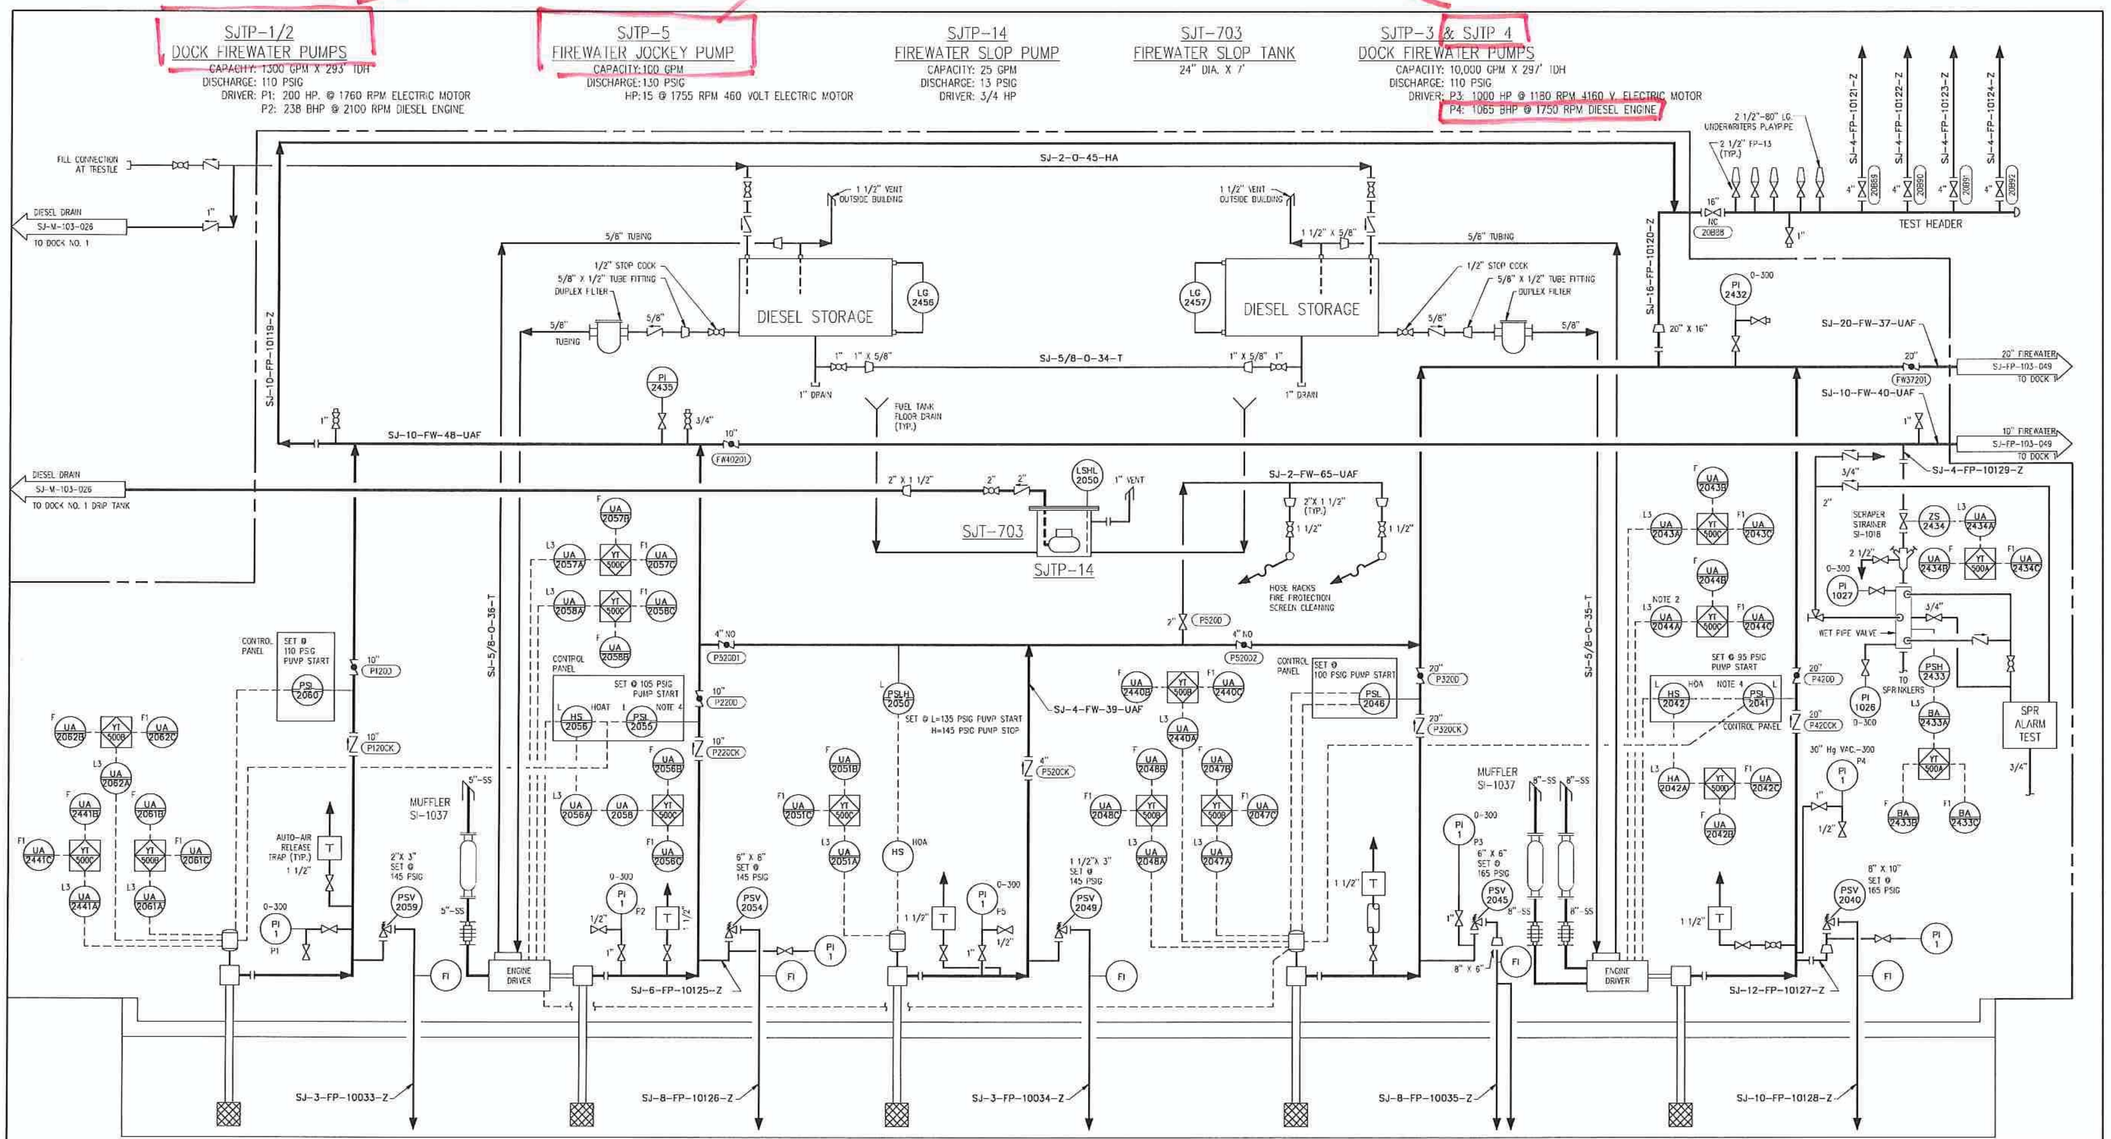

NOTES

1. FOR SYMBOLS AND LEGENDS SEE DRAWINGS: NS-M-150-001/002/003.
2. INDIVIDUAL LOCAL PANEL ALARM LIGHTS WITH COMMON HORN FOR OVERSPEED, OVERCRANK, HIGH WATER TEMP., LOW OIL PRESSURE, LOSS OF CHARGER OR AC POWER, AND LOW BATTERY.
3. ONLY PRIMARY INSTRUMENTS FIELD VERIFIED.
4. PSL-2055, PSL-2041 10 SECOND DELAY.
5. SITE CHECK DATE FROM: 11/16/92-11/20/92, 12/1/92-12/3/92.

SUPERSEDES DRAWING

DRAWING NO.	TASK	REV	DATE	REMARKS
P-103-001				

REGISTRATION STAMP

DESIGNED BY:
DRAWN BY:
CHECKED BY:
ENGINEER OF RECORD:
SIGNATURE:
DATE:
REVISION
NUMBER

NO.	CHANGE DESCRIPTION	DRAWN BY	CHECKED BY	PROJECT ENGINEER	ENGINEERING MANAGER	D.O.E. APPROVAL	DATE
2	AB PER PAN 17035, (MR-91-092), ECN 102	CJD	LNW				1/22/96
1	AB PER PAN 999-D, ECN 100, 101	RSY	BH				10/28/94
0	AB PER TASK NS-OM-032	JKM	EBH				9/1/93
	ORIGINAL INITIAL/SIGNATURE FOR REVISON BLOCK, P.E. SEAL AND						
	DOE APPROVAL, ARE ON HARD COPY ORIGINAL ON FILE WITH SPR						

PIPING & INSTRUMENT DIAGRAM
FIREWATER PUMPS

SJTP- 1 THROUGH 5
PUMP PLATFORM- 1

ST. JAMES TERMINAL
ST. JAMES PARISH, LOUISIANA

OFFICE OF SYSTEMS AND PROJECTS
STRATEGIC PETROLEUM RESERVE

APPROVED FOR CONSTRUCTION
DATE

TASK NUMBER:
DISCIPLINE: MECHANICAL
SCALE: NONE
DRAWING NUMBER: SJ-FP-103-048
SHEET 1 OF 1
REV. 2