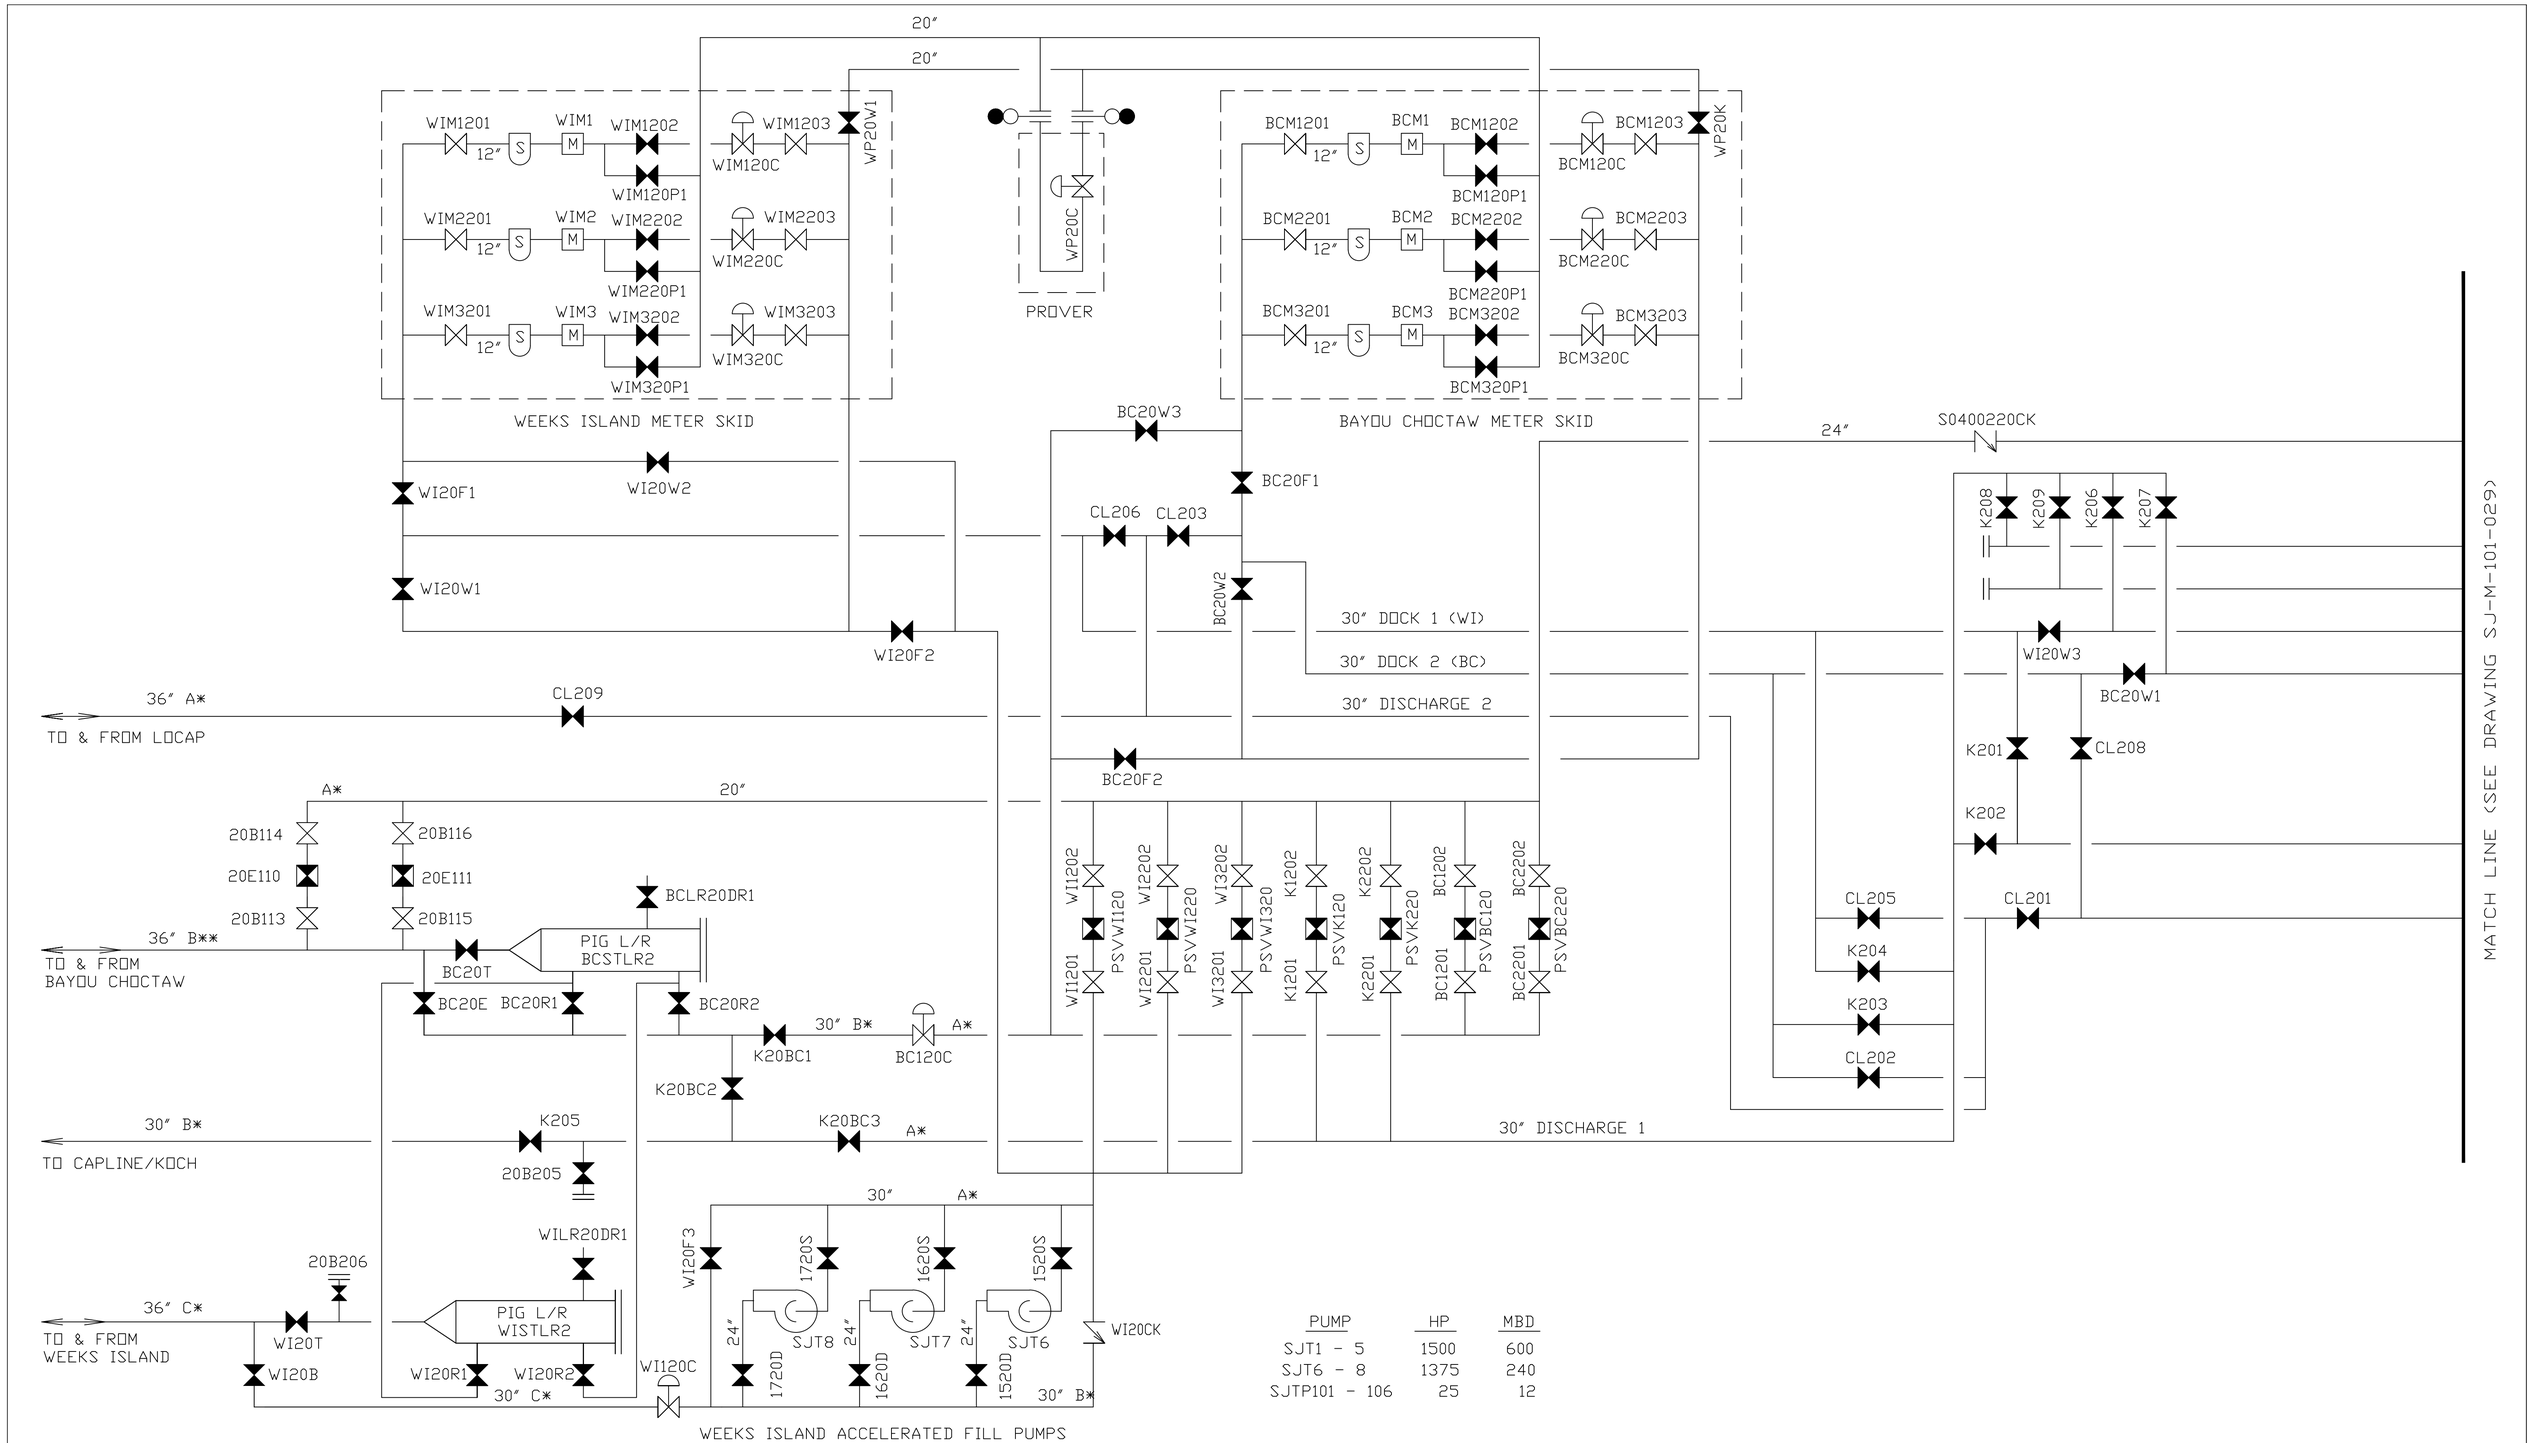

PUMP	HP	MBD
SJT1 - 5	1500	600
SJT6 - 8	1375	240
SJTP101 - 106	25	12

NOTE:

ALL PIPING RATED AS CLASS A* (275 PSIG) UNLESS OTHERWISE SHOWN AS CLASS B* (740 PSIG) OR CLASS C* (990 PSIG)

B** DERATED TO 300 PSIG

SURGE RELIEF VALVE (CLOSE)

CLOSE

OPEN

NO.	CHANGE DESCRIPTION	DRAWN BY	CHECKED BY	M/O APPROVAL	D.O.E. APPROVAL	DATE
3	REVISED PER PAN 70577, ECN 100	JMH	SAB			10/1/96
2	REVISED PER ECN 999.DOC	ESP	SAB	GAG	JC	3/24/95
1	DWG. MADE INTO 2 SHTS. ADDED MTR SKID VALVES	ESP	JFS	GAG	JCK	6/29/94
0	RELEASED FOR OPS MANUAL	ESP	RDM	REG	JCK	8/10/92

SITE OPERATIONS MANUAL

CRUDE OIL
STATIC LINEUP SHEET

ST. JAMES TERMINAL
ST. JAMES PARISH, LOUISIANA

OFFICE OF ENGINEERING AND CONSTRUCTION

STRATEGIC PETROLEUM RESERVE

PROJECT NUMBER:
TASK NUMBER:
DISCIPLINE: PROCESS
SCALE: NONE
DRAWING NUMBER: SJ-M-101-030
SHEET 1 OF 1
REV. 3

71010032